
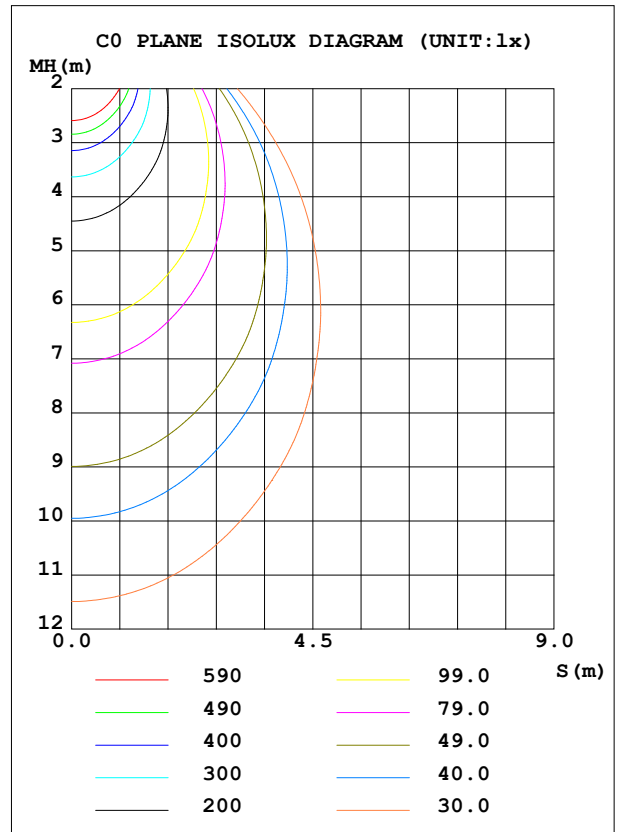


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:219.96V I:0.1781A P:38.424W PF:0.9806 Freq:50.00Hz Lamp Flux:6432.94x1 lm		
NAME: LED Linear Light	TYPE:	WEIGHT:
SPEC.: L1200xW62xH45MM	DIM.:	SERIAL No.:
MFR.: FOJO Lighting Technology CO., LTD	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 167.42 lm/W
MODEL	GP-62-120	I _{max} (cd)	3959	S/MH (C0/180)	1.06	
NOMINAL POWER (W)	40	LOR (%)	100.0	S/MH (C90/270)	1.08	
RATED VOLTAGE (V)	AC220V, 50/60Hz	TOTAL FLUX (lm)	6432.9	η UP, DN (C0-180)	0.2, 48.1	
NOMINAL FLUX (lm)	6432.94	CIE CLASS	DIRECT	η UP, DN (C180-360)	0.3, 51.4	
LAMPS INSIDE	1	η up (%)	0.5	CIBSE SHR NOM	1.00	
TEST VOLTAGE (V)	--	η down (%)	99.5	CIBSE SHR MAX	1.15	

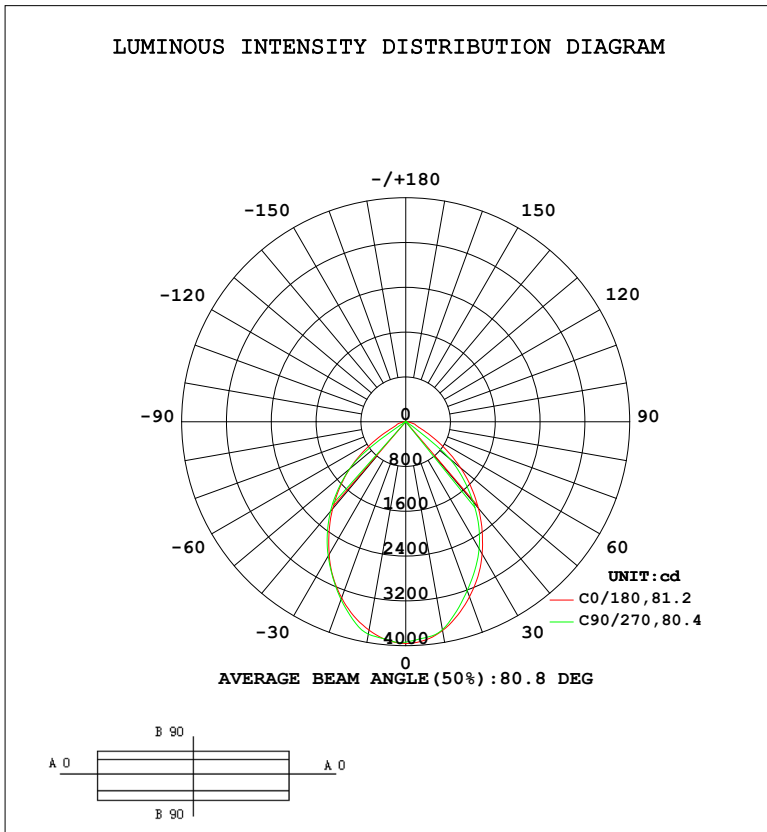

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature: 25.3°C
 Operators: XIAOXIN
 Test Date: 2025-08-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity: 65.0%
 Test Distance: 9.000m [K=1.0000]
 Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	3786	3781	3771	3764	3779	3814	3852	3819	0- 10	368.6	368.6	5.73,5.73
20	3327	3266	3210	3280	3348	3410	3378	3395	10- 20	1009	1378	21.4,21.4
30	2727	2675	2621	2674	2734	2802	2770	2779	20- 30	1399	2777	43.2,43.2
40	2020	1976	1877	1889	2032	2105	2094	2030	30- 40	1480	4257	66.2,66.2
50	1278	1159	1016	1095	1305	1318	1310	1282	40- 50	1243	5500	85.5,85.5
60	566.6	368.3	56.46	361.5	554.7	527.5	65.15	539.0	50- 60	668.5	6168	95.9,95.9
70	204.0	40.11	28.00	40.10	181.5	45.29	30.77	54.36	60- 70	161.5	6330	98.4,98.4
80	83.57	16.62	15.83	14.83	72.67	16.78	18.37	18.17	70- 80	54.84	6385	99.3,99.3
90	2.529	0.5544	0.3142	0.3648	1.222	1.711	3.083	2.427	80- 90	13.97	6399	99.5,99.5
100	1.113	1.091	0.6031	0.7197	2.421	1.681	1.317	2.000	90-100	1.080	6400	99.5,99.5
110	2.262	2.337	1.639	1.685	4.070	3.127	2.917	3.815	100-110	2.134	6402	99.5,99.5
120	3.744	3.932	3.249	3.052	5.983	4.992	4.996	5.921	110-120	3.554	6406	99.6,99.6
130	5.569	5.670	5.152	4.810	8.143	7.064	7.287	8.026	120-130	4.887	6410	99.6,99.6
140	7.499	7.631	7.455	6.760	10.19	9.224	9.794	10.16	130-140	5.802	6416	99.7,99.7
150	9.709	9.802	9.774	9.119	12.08	11.38	11.97	12.17	140-150	6.053	6422	99.8,99.8
160	12.05	12.13	12.36	11.64	13.72	13.34	13.86	13.74	150-160	5.450	6428	99.9,99.9
170	13.93	13.78	14.13	13.44	14.76	14.35	14.89	14.64	160-170	3.834	6432	100,100
180	14.83	14.53	15.06	14.50	14.85	14.54	15.07	14.51	170-180	1.383	6433	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 4925.9 lm

%lum = 76.6%

%lamp = 76.6%

Conical surface Flux(120deg): 6168.4 lm


%lum = 95.9%

%lamp = 95.9%

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: 10.0deg/s
Temperature:25.3°C
Operators:XIAOXIN
Test Date:2025-08-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
Humidity:65.0%
Test Distance:9.000m [K=1.0000]
Remarks:

LUMINANCE LIMITATION CURVES

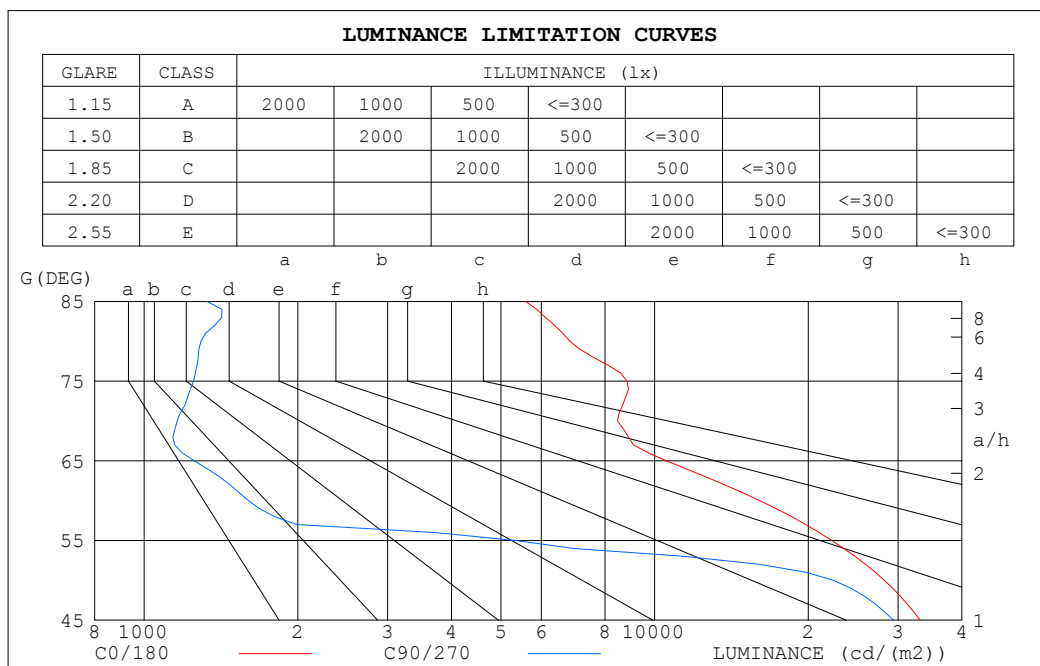


LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	5599	1331
80	6827	1293
75	8828	1250
70	8460	1161
65	10556	1254
60	16075	1602
55	22241	5345
50	28198	22419
45	33139	29394

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature: 25.3°C
 Operators: XIAOXIN
 Test Date: 2025-08-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity: 65.0%
 Test Distance: 9.000m [K=1.0000]
 Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Coefficients of Utilization(CU)									
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.99
1.0	1.08	1.05	1.02	1.06	1.03	1.01	1.02	.90	.97	.98	.96	.94	.94	.93	.92	.90
2.0	.98	.93	.89	.96	.91	.88	.93	.89	.85	.90	.86	.84	.87	.84	.82	.80
3.0	.89	.82	.77	.87	.81	.77	.84	.79	.75	.82	.78	.74	.79	.76	.73	.71
4.0	.81	.74	.68	.79	.73	.68	.77	.71	.67	.75	.70	.66	.73	.69	.65	.63
5.0	.74	.66	.61	.73	.66	.60	.71	.64	.60	.69	.63	.59	.67	.62	.59	.57
6.0	.67	.60	.55	.67	.59	.54	.65	.59	.54	.63	.58	.53	.62	.57	.53	.51
7.0	.62	.54	.49	.61	.54	.49	.60	.53	.49	.58	.53	.48	.57	.52	.48	.46
8.0	.57	.50	.45	.57	.50	.45	.55	.49	.44	.54	.48	.44	.53	.48	.44	.42
9.0	.53	.46	.41	.52	.46	.41	.51	.45	.41	.50	.45	.40	.49	.44	.40	.39
10.0	.49	.42	.38	.49	.42	.38	.48	.42	.37	.47	.41	.37	.46	.41	.37	.35

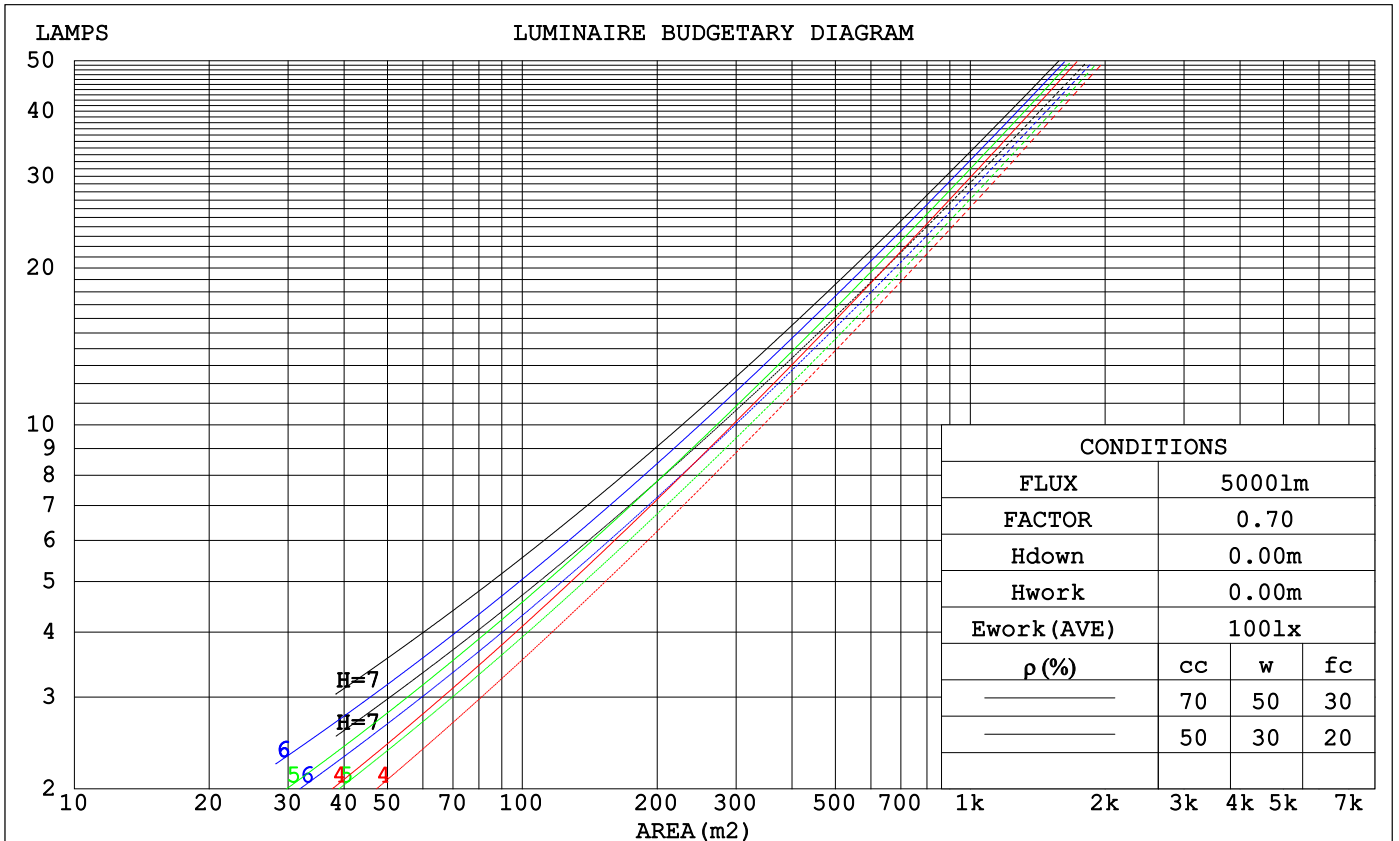

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature:25.3°C
 Operators:XIAOXIN
 Test Date:2025-08-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity:65.0%
 Test Distance:9.000m [K=1.0000]
 Remarks:

WEC AND CCEC

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.223	.127	.040	.216	.123	.039	.203	.116	.037	.191	.110	.035	.180	.104	.034	
2.0	.218	.119	.037	.212	.117	.036	.200	.111	.035	.190	.107	.033	.180	.102	.032	
3.0	.208	.111	.033	.203	.109	.033	.193	.105	.032	.184	.101	.031	.176	.097	.030	
4.0	.198	.103	.030	.194	.101	.030	.185	.098	.029	.177	.095	.029	.169	.092	.028	
5.0	.188	.096	.028	.184	.094	.027	.176	.092	.027	.169	.089	.027	.162	.087	.026	
6.0	.178	.089	.026	.174	.088	.025	.167	.086	.025	.161	.084	.025	.155	.082	.024	
7.0	.169	.083	.024	.165	.082	.023	.159	.081	.023	.154	.079	.023	.148	.077	.023	
8.0	.160	.078	.022	.157	.077	.022	.152	.076	.022	.146	.074	.021	.142	.073	.021	
9.0	.152	.073	.021	.149	.073	.020	.144	.071	.020	.140	.070	.020	.135	.069	.020	
10.0	.144	.069	.019	.142	.069	.019	.138	.067	.019	.133	.066	.019	.129	.065	.019	

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.195	.195	.195	.166	.166	.166	.113	.113	.113	.065	.065	.065	.021	.021	.021	
1.0	.178	.161	.145	.153	.138	.125	.104	.095	.086	.060	.055	.050	.019	.018	.016	
2.0	.166	.136	.111	.143	.117	.096	.098	.081	.067	.056	.047	.039	.018	.015	.013	
3.0	.157	.118	.087	.134	.102	.076	.092	.071	.053	.053	.041	.031	.017	.013	.010	
4.0	.148	.104	.070	.127	.090	.061	.088	.063	.043	.051	.037	.025	.016	.012	.008	
5.0	.141	.093	.058	.121	.081	.050	.083	.056	.035	.048	.033	.021	.016	.011	.007	
6.0	.134	.084	.048	.115	.073	.042	.080	.051	.030	.046	.030	.018	.015	.010	.006	
7.0	.128	.077	.042	.110	.067	.036	.076	.047	.026	.044	.028	.015	.014	.009	.005	
8.0	.123	.071	.036	.105	.062	.032	.073	.043	.022	.042	.026	.013	.014	.008	.004	
9.0	.117	.066	.032	.101	.058	.028	.070	.040	.020	.041	.024	.012	.013	.008	.004	
10.0	.112	.062	.029	.097	.054	.025	.067	.038	.018	.039	.022	.011	.013	.007	.004	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature:25.3°C
 Operators:XIAOXIN
 Test Date:2025-08-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity:65.0%
 Test Distance:9.000m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	22.7	23.9	23.0	24.1	24.3	20.9	22.1	21.1	22.3	22.5
3H	22.8	24.0	23.1	24.2	24.4	20.7	21.8	21.0	22.0	22.3
4H	22.9	24.0	23.2	24.2	24.5	20.6	21.7	20.9	21.9	22.2
6H	23.0	24.0	23.3	24.2	24.5	20.5	21.5	20.8	21.8	22.0
8H	23.0	23.9	23.3	24.2	24.5	20.5	21.4	20.8	21.7	22.0
12H	23.0	23.9	23.3	24.2	24.5	20.4	21.3	20.8	21.6	21.9
4H 2H	22.5	23.6	22.8	23.8	24.1	20.9	21.9	21.2	22.2	22.4
3H	22.7	23.6	23.1	23.9	24.2	20.7	21.6	21.0	21.9	22.2
4H	22.8	23.7	23.2	24.0	24.3	20.6	21.4	21.0	21.7	22.1
6H	22.9	23.6	23.3	24.0	24.3	20.5	21.2	20.9	21.6	22.0
8H	22.9	23.6	23.3	24.0	24.3	20.5	21.2	20.9	21.5	21.9
12H	22.9	23.5	23.4	23.9	24.3	20.5	21.1	20.9	21.4	21.9
8H 4H	22.7	23.4	23.1	23.7	24.1	20.5	21.2	20.9	21.5	21.9
6H	22.8	23.3	23.2	23.7	24.2	20.4	21.0	20.9	21.4	21.8
8H	22.8	23.3	23.3	23.7	24.2	20.4	20.9	20.9	21.3	21.8
12H	22.8	23.2	23.3	23.7	24.2	20.4	20.8	20.8	21.2	21.7
12H 4H	22.7	23.3	23.1	23.7	24.1	20.4	21.1	20.9	21.4	21.8
6H	22.7	23.2	23.2	23.6	24.1	20.4	20.9	20.8	21.3	21.7
8H	22.8	23.2	23.2	23.6	24.1	20.4	20.8	20.8	21.2	21.7
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 0.9 / - 1.2					+ 2.4 / - 8.8				
1.5H	+ 0.5 / - 0.7					+ 0.9 / - 3.3				
2.0H	+ 2.3 / - 4.4					+ 4.2 / -10.6				

CIE Pub.117, 6433 lm Total Lamp Luminous Flux Corrected (8log(F/F0) = 6.5)
 Area: 0.0705 m2

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature:25.3°C
 Operators:XIAOXIN
 Test Date:2025-08-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity:65.0%
 Test Distance:9.000m [K=1.0000]
 Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	70	60	55	69	60	54	68	60	54	49
0.80	80	71	65	79	70	65	77	70	64	59
1.00	88	79	74	87	79	74	85	79	73	67
1.25	94	86	81	93	86	81	90	84	80	74
1.50	98	91	86	96	90	85	94	88	84	78
2.00	103	97	92	101	96	92	98	94	90	84
2.50	105	100	96	104	99	95	100	96	93	86
3.00	108	103	99	106	101	98	102	99	96	88
4.00	110	106	103	108	105	102	104	101	99	91
5.00	112	109	106	110	107	104	105	103	101	92
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended				SHRNOM = 1.25			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature: 25.3°C
 Operators: XIAOXIN
 Test Date: 2025-08-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity: 65.0%
 Test Distance: 9.000m [K=1.0000]
 Remarks:


ISOCANDELA DIAGRAM

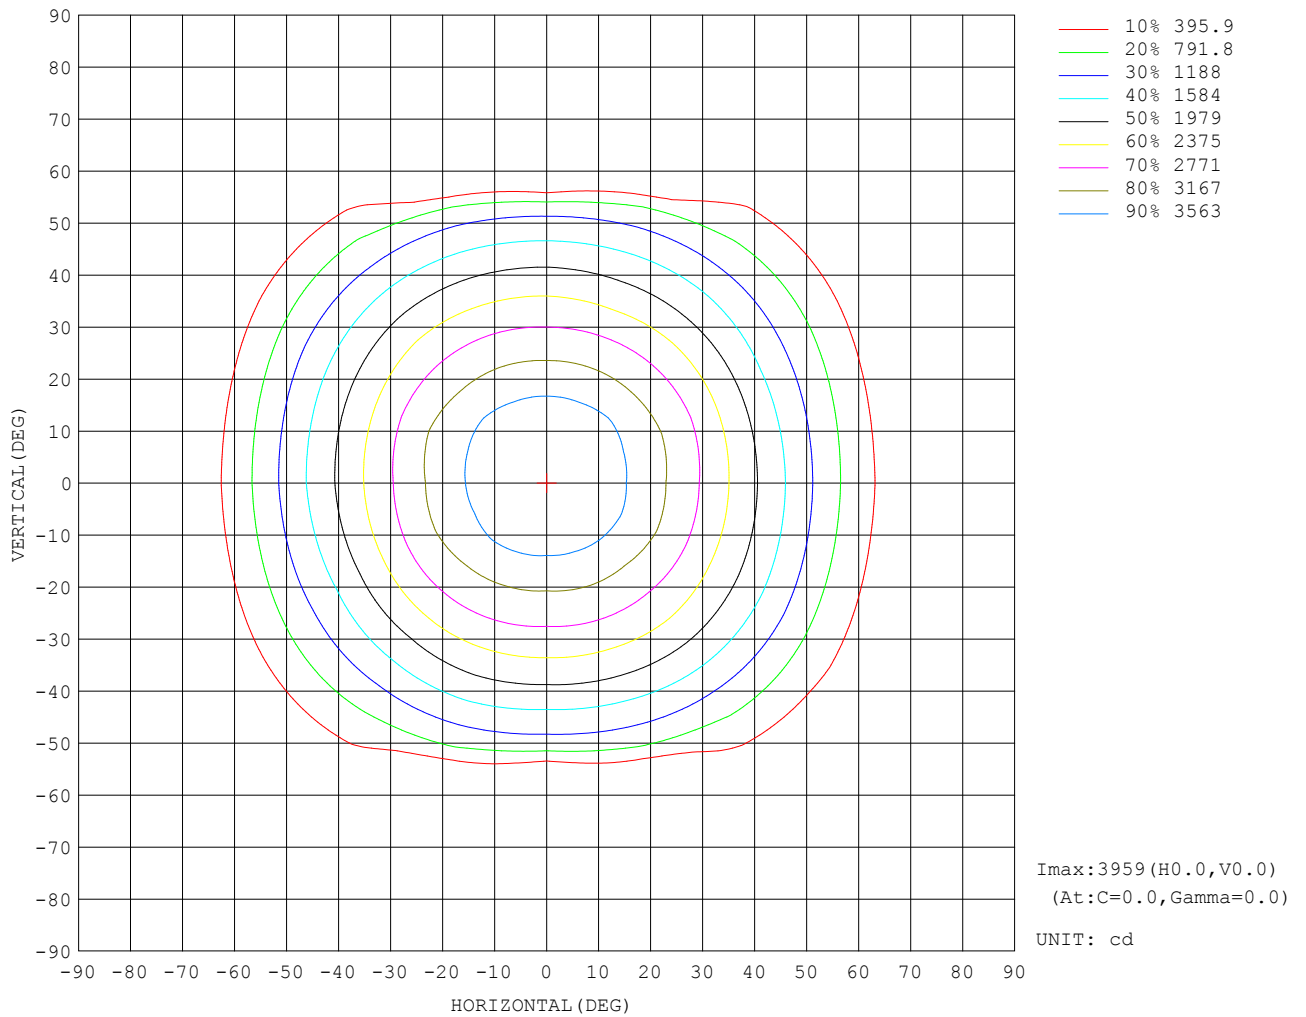

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: 10.0deg/s
Temperature: 25.3°C
Operators: XIAOXIN
Test Date: 2025-08-19

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-3000H_V1 SYSTEM V2.00.463
Humidity: 65.0%
Test Distance: 9.000m [K=1.0000]
Remarks:

AAI Figure

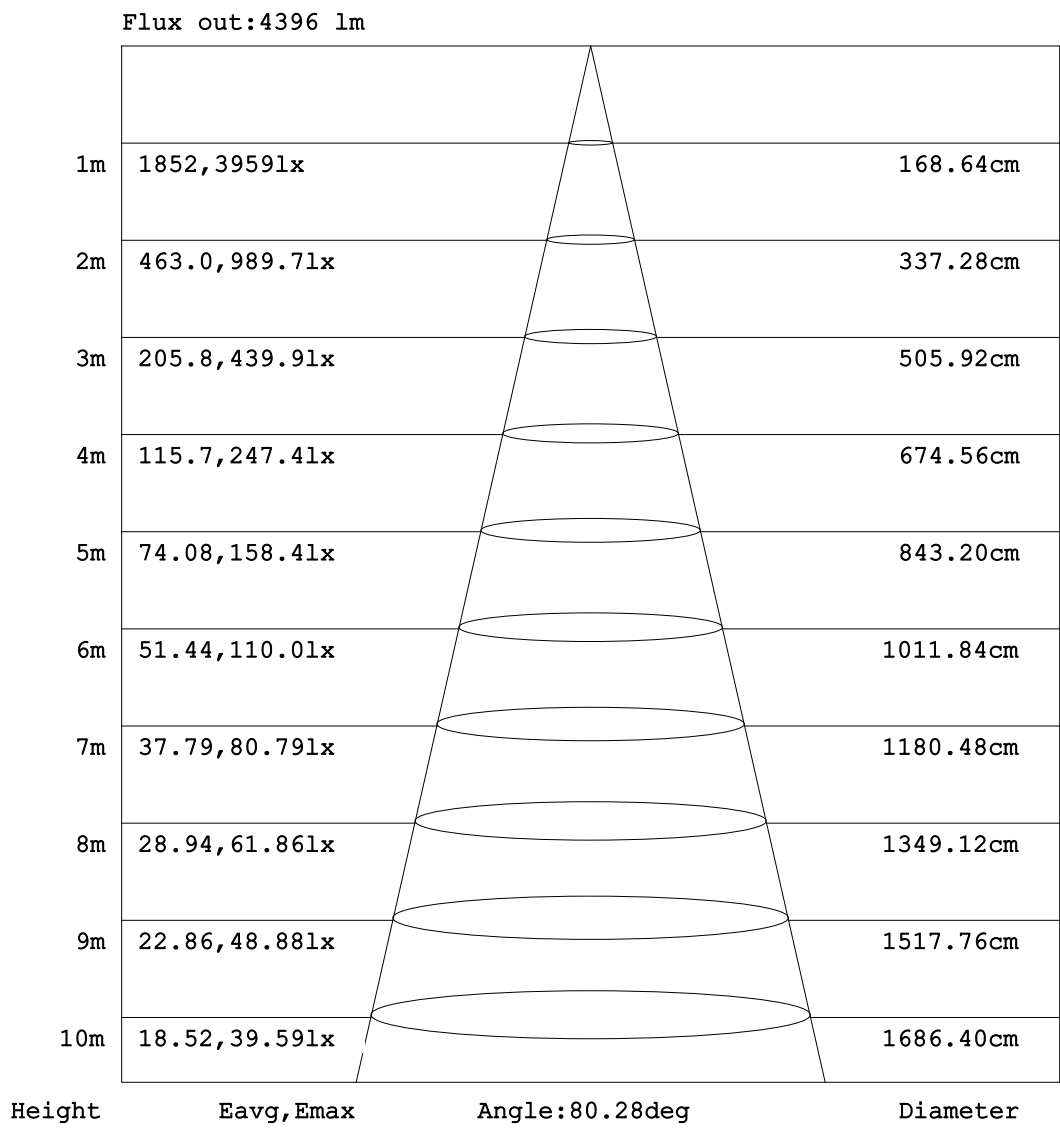


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature:25.3°C
 Operators:XIAOXIN
 Test Date:2025-08-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity:65.0%
 Test Distance:9.000m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM

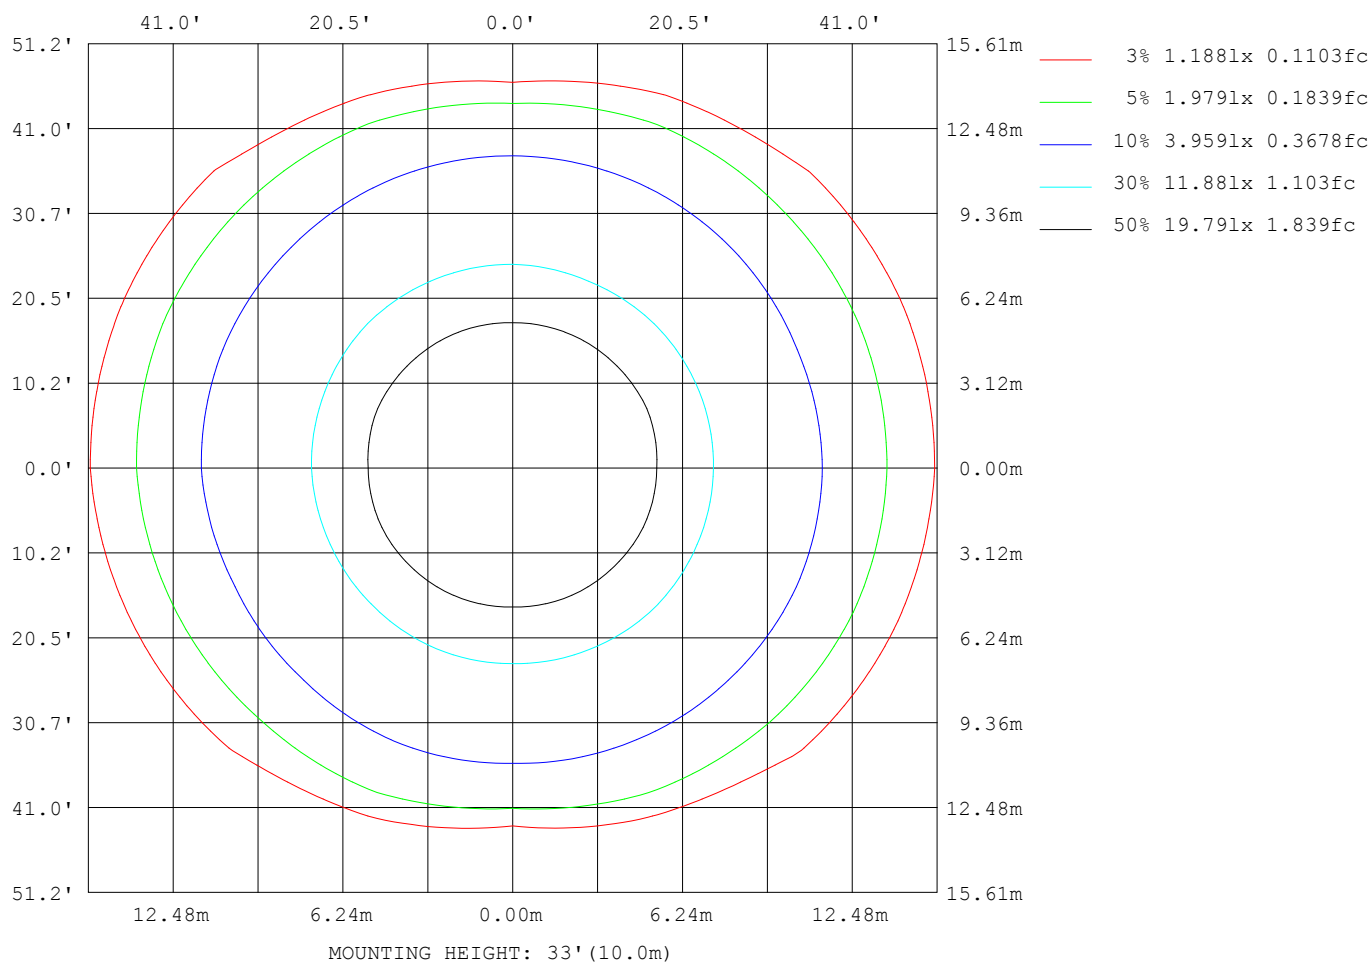

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature: 25.3°C
 Operators: XIAOXIN
 Test Date: 2025-08-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity: 65.0%
 Test Distance: 9.000m [K=1.0000]
 Remarks:

LED Avg.L Report

Test:U:219.96V I:0.1781A P:38.424W PF:0.9806 Freq:50.00Hz Lamp Flux:6432.94x1 lm		
NAME: LED Linear Light	TYPE:	WEIGHT:
SPEC.: L1200xW62xH45MM	DIM.:	SERIAL No.:
MFR.: FOJO Lighting Technology CO., LTD	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180 (65) av	9939
L_0~180 (75) av	8302
L_0~180 (85) av	5061
L_90~270 (65) av	1369
L_90~270 (75) av	1294
L_90~270 (85) av	1541
L_45 (65) av	3128
L_45 (75) av	1301
L_45 (85) av	1445

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: 10.0deg/s
Temperature:25.3℃
Operators:XIAOXIN
Test Date:2025-08-19

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
Humidity:65.0%
Test Distance:9.000m [K=1.0000]
Remarks:

Planar Illuminance Curve

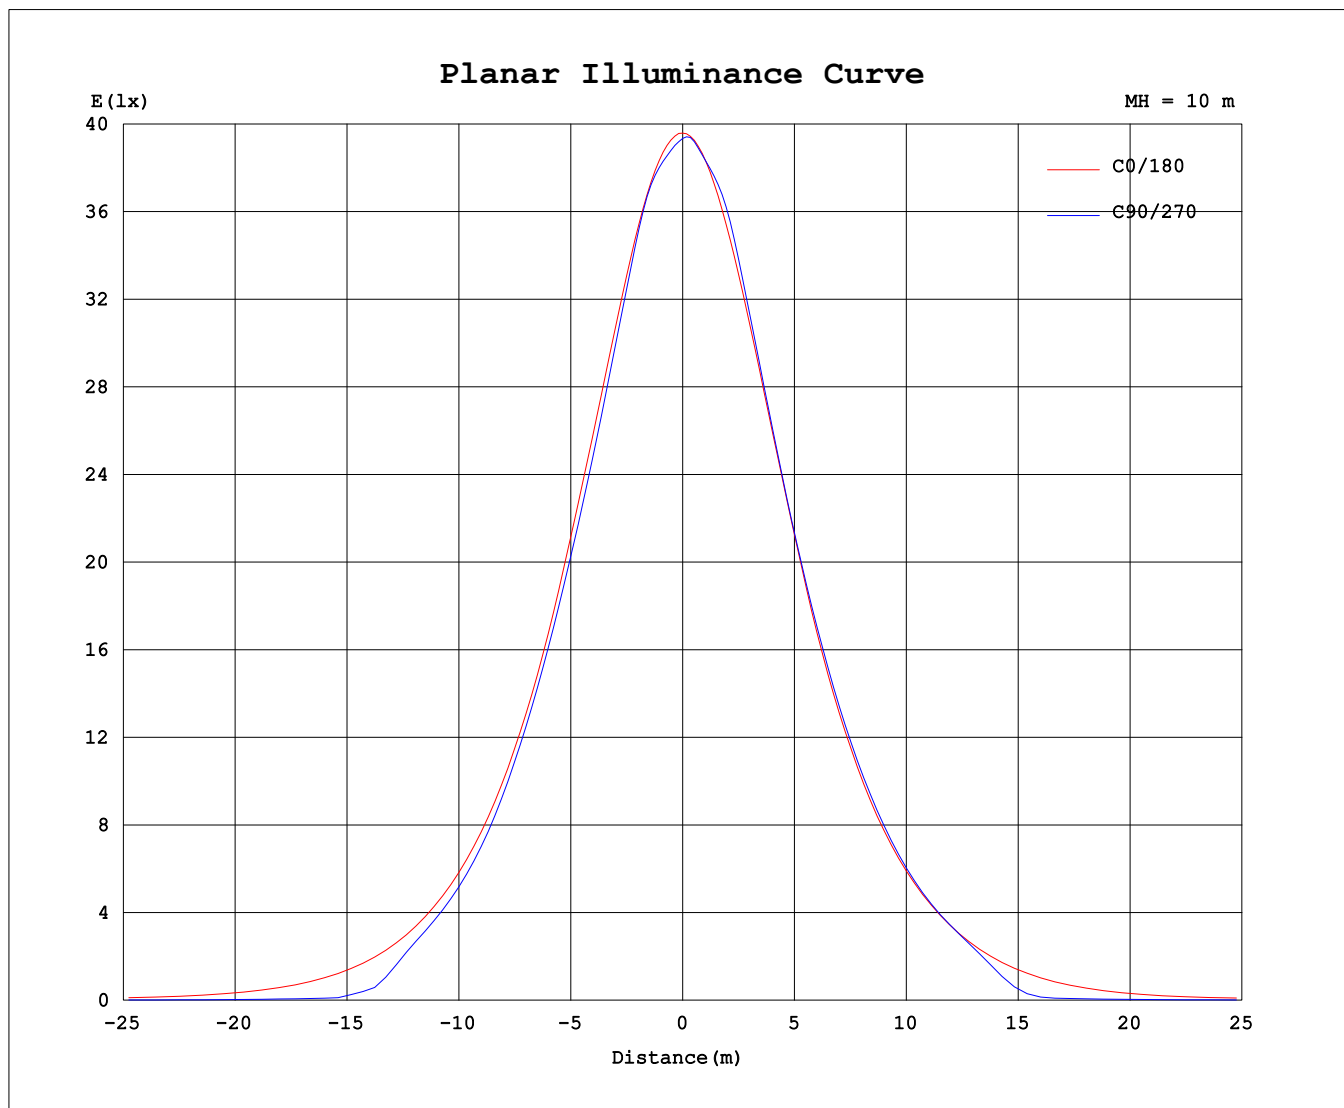

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: 10.0deg/s
Temperature:25.3°C
Operators:XIAOXIN
Test Date:2025-08-19

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
Humidity:65.0%
Test Distance:9.000m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: cd

C (DEG) \ γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	3959	3952	3944	3937	3935	3935	3934	3933	3959	3952	3944	3937	3935	3935	3934	3933			
5	3916	3897	3882	3880	3874	3869	3865	3868	3911	3917	3913	3904	3904	3900	3903	3901			
10	3786	3779	3781	3780	3771	3778	3764	3745	3779	3790	3814	3838	3852	3843	3819	3785			
15	3578	3589	3559	3520	3502	3526	3570	3563	3590	3619	3674	3659	3655	3657	3673	3606			
20	3327	3338	3266	3240	3210	3238	3280	3334	3348	3404	3410	3389	3378	3376	3395	3372			
25	3051	3046	2978	2958	2921	2955	2991	3057	3067	3147	3111	3103	3078	3089	3089	3112			
30	2727	2711	2675	2644	2621	2644	2674	2709	2734	2806	2802	2792	2770	2769	2779	2788			
35	2380	2357	2346	2300	2273	2285	2291	2325	2387	2432	2471	2455	2443	2405	2421	2409			
40	2020	2007	1976	1921	1877	1909	1889	1931	2032	2070	2105	2100	2094	2045	2030	2026			
45	1652	1636	1574	1509	1465	1506	1497	1540	1670	1702	1719	1721	1710	1686	1663	1632			
50	1278	1246	1159	1097	1016	1085	1095	1177	1305	1332	1318	1326	1310	1302	1282	1264			
55	899	847	755	432	216	461	711	814	916	940	913	828	577	835	885	910			
60	567	499	368	65.5	56.5	65.9	361	458	555	544	527	74.5	65.2	138	539	560			
65	314	248	76.7	40.5	37.4	40.5	77.8	198	278	245	85.9	46.2	44.2	49.0	132	275			
70	204	134	40.1	26.0	28.0	25.3	40.1	108	181	114	45.3	30.5	30.8	31.7	54.4	130			
75	161	74.8	23.4	21.7	22.8	21.1	21.0	76.4	142	70.8	23.6	22.9	24.4	23.3	27.1	91.2			
80	83.6	21.9	16.6	16.4	15.8	15.8	14.8	22.1	72.7	26.2	16.8	17.9	18.4	18.7	18.2	42.1			
85	34.4	10.0	8.38	8.57	8.18	7.84	7.02	7.75	27.8	9.56	9.38	10.9	10.8	11.6	10.7	12.8			
90	2.53	0.65	0.55	0.38	0.31	0.31	0.36	0.45	1.22	1.55	1.71	2.59	3.08	2.84	2.43	2.61			
95	0.73	0.83	0.70	0.48	0.33	0.34	0.44	0.62	1.76	1.46	1.17	0.88	0.73	0.93	1.33	1.67			
100	1.11	1.26	1.09	0.82	0.60	0.58	0.72	0.97	2.42	2.07	1.68	1.41	1.32	1.56	2.00	2.42			
105	1.64	1.83	1.64	1.31	1.05	0.98	1.14	1.44	3.19	2.79	2.37	2.08	2.07	2.37	2.85	3.28			
110	2.26	2.52	2.34	1.97	1.64	1.52	1.68	2.01	4.07	3.60	3.13	2.88	2.92	3.28	3.82	4.26			
115	2.97	3.29	3.09	2.75	2.38	2.21	2.31	2.69	5.03	4.49	4.02	3.80	3.90	4.31	4.81	5.30			
120	3.74	4.07	3.93	3.55	3.25	3.02	3.05	3.40	5.98	5.40	4.99	4.83	5.00	5.35	5.92	6.32			
125	4.63	5.02	4.76	4.36	4.18	3.83	3.89	4.33	7.06	6.51	5.99	5.90	6.16	6.38	6.97	7.48			
130	5.57	5.91	5.67	5.31	5.15	4.79	4.81	5.18	8.14	7.52	7.06	6.99	7.29	7.43	8.03	8.54			
135	6.52	6.82	6.64	6.37	6.29	5.85	5.79	6.13	9.20	8.59	8.18	8.18	8.53	8.57	9.10	9.58			
140	7.50	7.86	7.63	7.47	7.45	6.95	6.76	7.16	10.2	9.65	9.22	9.38	9.79	9.72	10.2	10.6			
145	8.57	8.96	8.67	8.55	8.60	8.10	7.89	8.27	11.2	10.7	10.3	10.5	10.9	10.8	11.2	11.6			
150	9.71	10.1	9.80	9.67	9.77	9.35	9.12	9.42	12.1	11.7	11.4	11.6	12.0	11.9	12.2	12.5			
155	11.0	11.3	11.0	10.9	11.1	10.6	10.4	10.6	13.0	12.6	12.4	12.6	13.0	12.9	13.0	13.3			
160	12.0	12.3	12.1	12.2	12.4	11.9	11.6	11.7	13.7	13.4	13.3	13.4	13.9	13.7	13.7	14.0			
165	13.1	13.2	13.1	13.2	13.4	12.9	12.6	12.7	14.3	14.0	14.0	14.1	14.5	14.3	14.3	14.5			
170	13.9	14.0	13.8	13.9	14.1	13.9	13.4	13.5	14.8	14.5	14.4	14.6	14.9	14.8	14.6	14.8			
175	14.5	14.5	14.3	14.5	14.7	14.5	14.1	14.2	14.9	14.7	14.6	14.9	15.1	14.9	14.7	14.9			
180	14.8	14.7	14.5	14.8	15.1	14.8	14.5	14.6	14.9	14.7	14.5	14.8	15.1	14.8	14.5	14.6			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature:25.3°C
 Operators:XIAOXIN
 Test Date:2025-08-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity:65.0%
 Test Distance:9.000m [K=1.0000]
 Remarks: